


# TEMPORARY APPROVAL

## PROPERTY SIDE CONNECTION TO CITY-MAINTAINED SEWER CLEANOUT STACK (FOR EXISTING SEWER CONNECTIONS ONLY)

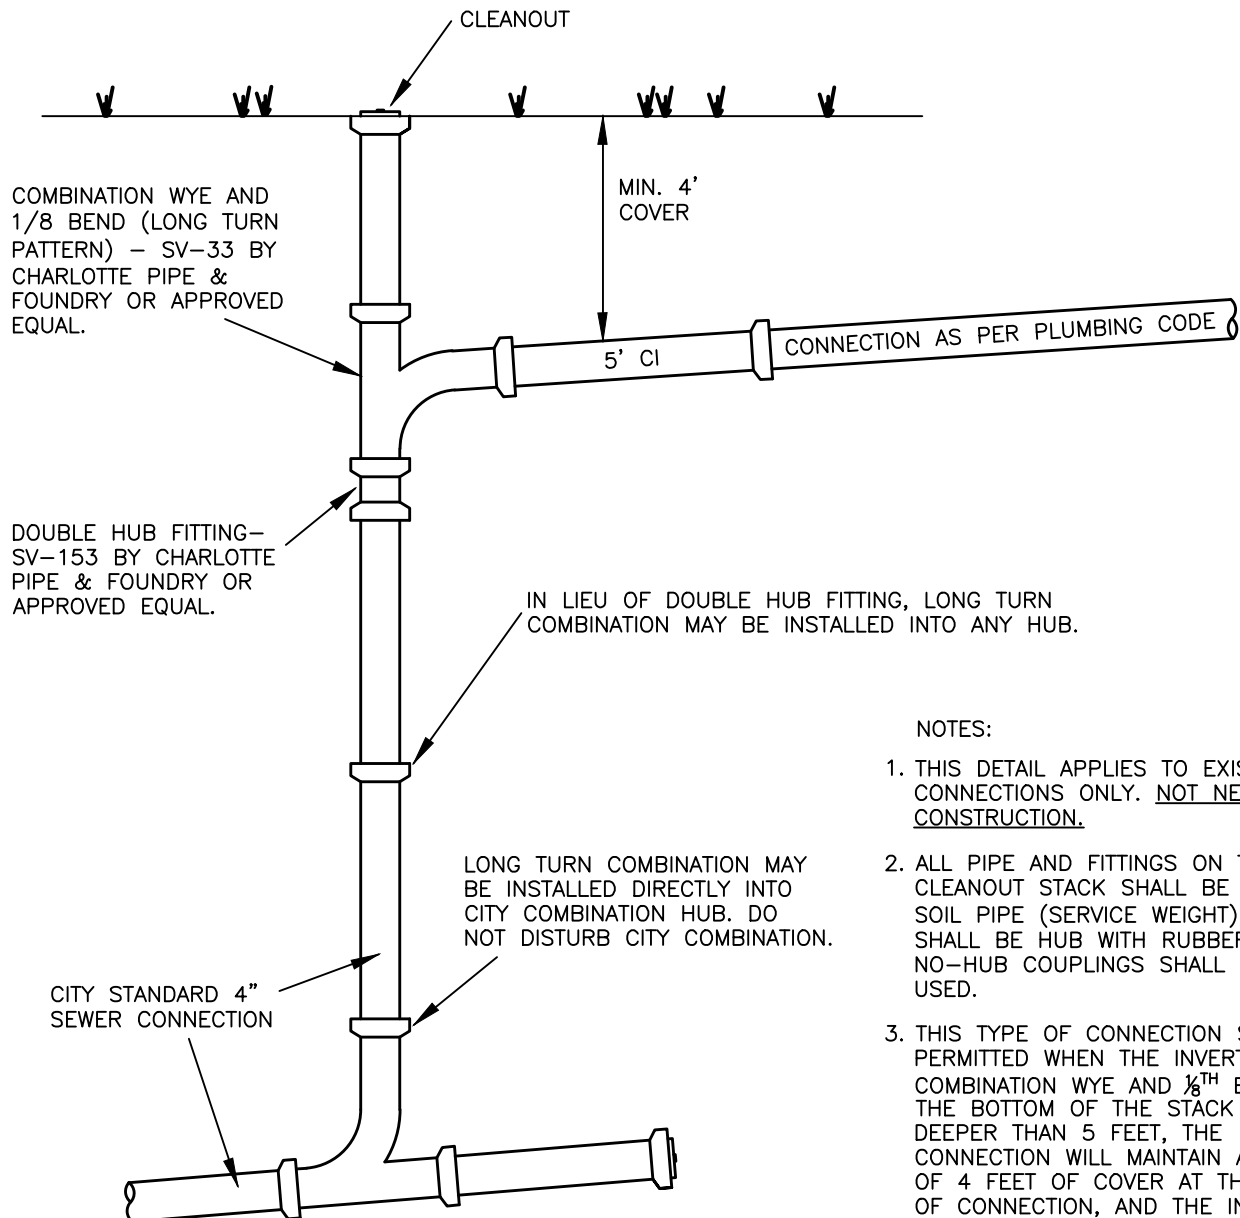

### NOTES:

1. THIS DETAIL APPLIES TO EXISTING CONNECTIONS ONLY. NOT NEW CONSTRUCTION.
2. ALL PIPE AND FITTINGS ON THE CLEANOUT STACK SHALL BE CAST IRON SOIL PIPE (SERVICE WEIGHT). JOINTS SHALL BE HUB WITH RUBBER GASKET. NO-HUB COUPLINGS SHALL NOT BE USED.
3. THIS TYPE OF CONNECTION SHALL BE PERMITTED WHEN THE INVERT OF THE COMBINATION WYE AND  $\frac{1}{8}$ <sup>TH</sup> BEND AT THE BOTTOM OF THE STACK IS DEEPER THAN 5 FEET, THE CONNECTION WILL MAINTAIN A MINIMUM OF 4 FEET OF COVER AT THE POINT OF CONNECTION, AND THE INVERT OF THE COMBINATION WYE AND  $\frac{1}{8}$ <sup>TH</sup> BEND IS MORE THAN 16" DEEPER THAN THE PROPOSED TIE-IN. IF THESE CONDITIONS ARE NOT MET, THE CONNECTION SHALL OCCUR UTILIZING THE TAIL PIECE FROM THE COMBINATION WYE AT THE BOTTOM OF THE STACK AS SHOWN IN THE CITY OF WINSTON-SALEM TECHNICAL SPECIFICATIONS AND DETAIL DRAWINGS FOR WATER LINE & SEWER LINE CONSTRUCTION.

CITY OF WINSTON-SALEM  
DEPARTMENT OF PUBLIC WORKS  
ENGINEERING DIVISION

N.T.S. REVISED 4-11-19

R:\Data\Utility\Utility Spec Drawings\sewer cleanout stack.dwg